



In this issue we have articles on:

- Compliance Documents – NZBC Clause B2 Durability
  - New Version
  - Amendment 7
- Quiz on articles in this newsletter

For any enquiries regarding this news sheet, please contact Simon Tonkin on **(03) 211 1777**

**COMPLIANCE DOCUMENT  
NEW ZEALAND BUILDING CODE  
CLAUSE B2 DURABILITY**



Department of  
Building and Housing  
*Te Tari Kaupapa Whare*

The Department of Building and Housing has released Amendment 7 of Clause B2 – Durability.

Please note that the new version of the Acceptable Solution (in Amendment 7) takes effect on 4 April 2011. However, there will be a transition period where the existing version (Amendment 6) can be used for consenting purposes up to and including 30 June 2011. From 1 July 2011 only Amendment 7 applies.

Clause B2 – durability is reproduced for your information.

Please note that the changes are clearly signalled in the document. Look to the bottom of the page and it will have a date – the latest date is 4 April 2011.

You can then check that page and the changes / additions are clearly acted.

The flow chart, figure 1 assessment of durability requirement has not changed and its date at the bottom of the page is 28 February 1998.

You will note the compliance document has page numbers shown as ⑦. You will also note that these numbers are not concurrent as there is no ⑥ for example. This is because this page is blank so obviously we haven't copied a blank page.

### Status of Compliance Documents

Compliance Documents are prepared by the Department of Building and Housing in accordance with section 22 of the Building Act 2004. A Compliance Document is for use in establishing compliance with the New Zealand Building Code.

A person who complies with a Compliance Document will be treated as having complied with the provisions of the Building Code to which the Compliance Document relates. However, a Compliance Document is only one method of complying with the Building Code. There may be alternative ways to comply.

Users should make themselves familiar with the preface to the New Zealand Building Code Handbook, which describes the status of Compliance Documents and explains alternative methods of achieving compliance.

Defined words (italicised in the text) and classified uses are explained in Clauses A1 and A2 of the Building Code and in the Definitions at the start of this Compliance Document.

<b>B2: Document History</b>			
	<b>Date</b>	<b>Alterations</b>	
First published	July 1992		
Amendment 1	September 1993	p. 3, Table 1	
Second Edition	28 February 1998	Document revised – second edition issued	
Amendment 2	1 December 2000	p. ii, Document History p. v, Contents p. vi, References	p. 5, 3.2.2, 3.3, 3.4 p. 9, Index
Amendment 3	1 July 2001	p. 2, Document History, Status p. 7, References	p. 8, 5.0.1
Amendment 4	1 April 2004	p. 2, Document History p. 7, References pp. 9–10, Definitions	p. 15, 3.2.1 Comment pp. 17–22 Table 1 p. 23 Index
Amendment 5	1 April 2004	p. 7, References p. 9, Definitions	p. 15, 3.2.1, 3.2.2, 3.2.3
Amendment 5 regarding timber treatment is subject to a transitional provision.			
Reprinted incorporating Amendments 3, 4 and 5	April 2004		
Amendment 6	Published 30 June 2010 Effective from 30 September 2010	p. 2, Document History, Status p. 5, Contents p. 7, References	pp. 9–10, Definitions pp. 13–15, B2/AS1 1.1, 3.1.1, 3.2.1, 3.2.2
Reprinted incorporating Amendment 6	Published 30 June 2010 Effective 30 September 2010		
Amendment 7	Effective 4 April 2011 Supersedes Amendment 6 version 30 July 2011	p. 2, Document History, Status p. 5, Contents	p. 7, References pp. 15–15F, 3.2.1, 3.2.2, 3.2.3
Notes:			
<ul style="list-style-type: none"> <li>• B2/AS1 Amendment 7 version is effective from 4 April 2011.</li> <li>• Up to 30 June 2011, B2/AS1 Amendment 6 version may also be used.</li> <li>• From 1 July 2011, only B2/AS1 Amendment 7 version applies, and supersedes all previous versions of the document.</li> </ul>			
Note: Page numbers relate to the document at the time of Amendment and may not match page numbers in current document.			

### Document Status

The most recent version of this document, as detailed in the Document History, is approved by the Chief Executive of the Department of Building and Housing.

People using this Compliance Document should check for amendments on a regular basis. The Department of Building and Housing may amend any part of any Compliance Document at any time. Up-to-date versions of Compliance Documents are available from [www.dbh.govt.nz](http://www.dbh.govt.nz)

# New Zealand Building Code

## Clause B2 Durability

This Clause is extracted from the New Zealand Building Code contained in the First Schedule of the Building Regulations 1992 and amended by the Building Regulations 1997.

### FIRST SCHEDULE—continued

#### Clause B2-DURABILITY

##### Provisions

##### OBJECTIVE

**B2.1** The objective of this provision is to ensure that a *building* will throughout its life continue to satisfy the other objectives of this code.

##### FUNCTIONAL REQUIREMENT

**B2.2** *Building materials, components and construction methods shall be sufficiently durable to ensure that the building, without reconstruction or major renovation, satisfies the other functional requirements of this code throughout the life of the building.*

##### PERFORMANCE

**B2.3.1** *Building elements must, with only normal maintenance, continue to satisfy the performance requirements of this code for the lesser of the specified intended life of the building, if stated, or:*

- (a) The life of the building, being not less than 50 years, if:
  - (i) Those *building elements* (including floors, walls, and fixings) provide structural stability to the building, or
  - (ii) Those *building elements* are difficult to access or replace, or
  - (iii) Failure of those *building elements* to comply with the *building code* would go undetected during both normal use and maintenance of the *building*.
- (b) 15 years if:
  - (i) Those *building elements* (including the *building envelope, exposed plumbing in the subfloor space, and in-built chimneys and flues*) are moderately difficult to access or replace, or

##### Limits on application

Performance B2.3.1 applies from the time of issue of the applicable *code compliance certificate*. *Building elements* are not required to satisfy a durability performance which exceeds the *specified intended life of the building*.

## FIRST SCHEDULE—continued

Provisions	Limits on application
<p>(ii) Failure of those <i>building elements</i> to comply with the <i>building code</i> would go undetected during normal use of the <i>building</i>, but would be easily detected during normal maintenance.</p> <p>(c) 5 years if:</p> <p>(i) The <i>building elements</i> (including services, linings, renewable protective coatings, and <i>fixtures</i>) are easy to access and replace, and</p> <p>(ii) Failure of those <i>building elements</i> to comply with the <i>building code</i> would be easily detected during normal use of the <i>building</i>.</p>	
<p><b>B2.3.2</b> Individual <i>building elements</i> which are components of a <i>building system</i> and are difficult to access or replace must either:</p>	
<p>(a) All have the same durability, or</p> <p>(b) Be installed in a manner that permits the replacement of <i>building elements</i> of lesser durability without removing <i>building elements</i> that have greater durability and are not specifically designed for removal and replacement.</p>	

# Contents

	<b>Page</b>
<b>References</b>	<b>7</b>
<b>Definitions</b>	<b>9</b>
<b>Verification Method B2/VM1</b>	<b>11</b>
<b>1.0 Durability Evaluation</b>	<b>11</b>
1.1 In-service history	11
1.2 Laboratory testing	11
1.3 Similar materials	11
<b>Acceptable Solution B2/AS1</b>	<b>13</b>
<b>1.0 Durability Applications</b>	<b>13</b>
Amend 6   1.1 Compliance Documents	13
Sep 2010   1.2 Assessing required durability	13
1.3 Examples of durability requirements	14
<b>2.0 Maintenance</b>	<b>14</b>
2.1 Normal maintenance	14
2.2 Scheduled maintenance	14
<b>3.0 Generic Materials</b>	<b>14</b>
3.1 Concrete	14
3.2 Timber	15
Amend 7   3.3 Solid plastering	15F
Apr 2011   3.4 Earth buildings	15F
Amend 2	
Dec 2000	
<b>Index</b>	<b>23</b>

# References

For the purposes of New Zealand Building Code (NZBC) compliance, the Standards and documents referenced in this Verification Method and Acceptable Solution (primary reference documents) must be the editions, along with their specific amendments, listed below. Where these primary reference documents refer to other Standards or documents (secondary reference documents), which in turn may also refer to other Standards or documents, and so on (lower-order reference documents), then the version in effect at the date of publication of this Verification Method and Acceptable Solution must be used.

Amend 7  
Apr 2011  
Amend 6  
Sep 2010

## Standards New Zealand

NZS 3101:- Concrete structures standard  
Part 1: 2006 The design of concrete structures  
*Amend: 1, 2*

Amend 7  
Apr 2011

NZS 3602:-

Amend 5  
Apr 2004

Part 1: 2003 Timber and wood-based products for use in building

Amend 3  
Jul 2001  
Amend 2  
Dec 2000

NZS 3604: 1999 Timber framed buildings  
*Amend: 1*

Amend 7  
Apr 2011

NZS 3640: 2003 Chemical Preservation of round and sawn timber  
*Amend: 1, 2, 3 and 4*

Amend 6  
Sep 2010

NZS 4251:- Solid plastering  
Part 1: 2007 Cement plaster for walls, ceilings and soffits

Amend 2  
Dec 2000

NZS 4297: 1998 Engineering design for earth buildings

NZS 4299: 1998 Earth buildings not requiring specific design  
*Amend: 1*

## Where Quoted

AS1 3.1.1

AS1 3.2.1, 3.2.2

AS1 3.2.3

AS1 3.2.1, 3.2.3

AS1 3.3.1

AS1 3.4.1

AS1 3.4.1

Amend 5  
Apr 2004

Amend 5  
Apr 2004

# Definitions

Amend 6  
Sep 2010 | This is an abbreviated list of definitions for words or terms particularly relevant to this Compliance Document. The definitions for any other italicised words may be found in the New Zealand Building Code Handbook.

**Adequate** *Adequate* to achieve the objectives of the *building code*.

**Baluster** A post providing the support for the top and bottom rails of a barrier.

Amend 4  
Apr 2004

**Balustrade** The infill parts of a barrier (typically between floor and top rail).

Amend 6  
Sep 2010

**Building** has the meaning given to it by sections 8 and 9 of the *Building Act 2004*.

Amend 4  
Apr 2004

**Building Code** means the regulations made under section 400 of the *Building Act 2004*.

**Building element** Any structural and non-structural component or assembly incorporated into or associated with a *building*. Included are *fixtures*, services, *drains*, permanent mechanical installations for access, glazing, partitions, ceilings and temporary supports.

Amend 4  
Apr 2004

**Cladding** The exterior weather-resistant surface of a *building*.

Amend 5  
Apr 2004

**Code compliance certificate** means a certificate issued by a *building consent authority* under section 95 of the *Building Act 2004*.

Amend 6  
Sep 2010

**Damp-proof course (DPC)** A narrow strip (generally up to 300 mm wide) of *durable vapour barrier* placed between *building elements* to prevent the passage of moisture from one element to another.

**Damp-proof membrane (DPM)** A sheet material, coating or vapour barrier, having a low water vapour transmission, and used to prevent water and water vapour movement through concrete in contact with the ground. (Also known as a concrete underlay.)

Amend 4  
Apr 2004

**Durable** Resistant to wear and decay.

**External wall** Any exterior face of a *building* within 30° of vertical, consisting of *primary* and/or *secondary elements* intended to provide protection against the outdoor environment, but which may also contain *unprotected areas*.

Amend 4  
Apr 2004

**Fixture** An article intended to remain permanently attached to and form part of a *building*.

**Flue** The passage through which the products of combustion are conveyed to the outside.

**Handrail** A rail to provide support to, or assist with the movement of a *person*.

Amend 4  
Apr 2004

**Hazardous** Creating an unreasonable risk to people of bodily injury or deterioration of health.

**Intended use** in relation to a *building*,

(a) includes any or all of the following:

- (i) any reasonably foreseeable occasional use that is not incompatible with the *intended use*;
- (ii) normal maintenance;
- (iii) activities undertaken in response to *fire* or any other reasonably foreseeable emergency; but

(b) does not include any other maintenance and repairs or rebuilding.

Amend 6  
Sep 2010

**Person** includes the Crown, a corporation sole, and also a body of *persons*, whether corporate or unincorporated.

**Primary element** A *building element* providing the basic load bearing capacity to the structure, and which if affected by *fire* may initiate instability or premature structural collapse.

**Secondary element** A *building element* not providing load bearing capacity to the structure and if affected by *fire*, instability or collapse of the *building* structure will not occur.

Amend 4  
Apr 2004

Amend 6  
Sep 2010

**Specified intended life** has the meaning given to it by section 113(3) of the Building Act 2004.

Section 113(3) states:

"(3) In subsection (2), **specified intended life**, in relation to a building, means the period of time, as stated in an application for a building consent or in the consent itself, for which the building is proposed to be used for its intended use."

**Unprotected area** in relation to an *external wall* of a *building*, means any part of the *external wall* which is not *fire* rated or has less than the required *FRR*.

**COMMENT:**

*Unprotected area* includes non-fire rated windows, doors, or other openings, and non-fire rated *external wall* construction.

**Vapour barrier** Sheet material or coating having a low water-vapour transmission, and used to minimise water-vapour penetration in *buildings*. (*Vapour barriers* are sometimes referred to as *damp-proof membranes*.)

Amend 4  
Apr 2004

**Water heater** A device for heating water.

# Verification Method B2/VM1

## 1.0 Durability Evaluation

**1.0.1** Verification that the durability of a *building element* complies with the NZBC B2.3.1 and B2.3.2 will be by proof of performance and shall take into account the expected in-service exposure conditions by one or more of the following:

- a) In-service history,
- b) Laboratory testing,
- c) Comparable performance of similar *building elements*.

### 1.1 In-service history

**1.1.1** Verification of durability based on in-service history of a *building element*, including materials, components and systems shall take into account but not be limited to:

- a) Length of service,
- b) Environment of use,
- c) Intensity of use,
- d) Any reaction with adjacent materials,
- e) Limitations in performance,
- f) Degree of degradation, and
- g) Changes in formulation.

### 1.2 Laboratory testing

**1.2.1** Verification of durability based on successful performance in a laboratory test shall be accompanied by an assessment of the tests performed, their relevance to field and service conditions, and in particular:

- a) Types of degradation mechanisms likely to be induced by testing,
- b) The degradation mechanisms likely in service,
- c) Details of methods of assessment,
- d) Variability of results, and
- e) The relevance of the test to the *building element* under study.

## 1.3 Similar materials

**1.3.1** For the purposes of evaluation, a *building element* may be considered as similar to another *building element* with proven performance, if both are subject to the same controls for composition and overall performance. Examples of such controls are Approved Documents or Standards. Where such a direct comparison is not possible, the *building element* shall be independently assessed to determine the degree of similarity.

**1.3.2** Assessment shall take into account but not be limited to:

- a) Product composition,
- b) Method and quality assurance of manufacture,
- c) Degradation mechanisms,
- d) Local environment,
- e) Conditions of use,
- f) Required maintenance, and
- g) Performance in use.

#### COMMENT:

Environment

1. To be acceptable, any opinion in support of the assessed durability for a *building element* shall clearly identify the conditions of use and the environment under which that durability will be achieved. If the *building element* can be reasonably expected to be used in circumstances which will reduce the durability, any limitations in use shall be clearly identified and evaluated.
2. Circumstances which need to be considered include, but are not limited to:
  - a) Maintenance required to achieve the required durability (e.g. painting, cleaning, replacing high wear items such as washers),
  - b) Installation details of the total system (e.g. fixings, flashings, jointing materials),
  - c) Compatibility with other materials (e.g. galvanic corrosion, plasticiser migration).

**DURABILITY**

*Verification Method B2/VM1*

- d) Locality or macroclimatic effects (e.g. coastal or thermal areas, wet or damp ground conditions),
- e) Microclimatic effects (e.g. sheltered areas on buildings such as eaves),
- f) External environment influences (e.g. local industrial operations such as fertiliser works), and
- g) Internal environment (e.g. swimming pools, chemical processing areas, sauna rooms).

# Acceptable Solution B2/AS1

## 1.0 Durability Applications

**1.0.1** This acceptable solution applies to materials and components required to satisfy the performances specified in other NZBC clauses.

### COMMENT:

All *building work* shall comply with the NZBC. This means that *building elements*, both individually and as part of a system, shall meet all the performances required by the applicable NZBC clauses and shall continue to do so for the required durability period. In some cases, *building elements* (e.g. decorative coatings and trim) are not required to satisfy an NZBC performance criterion. Such *building elements* will then have no B2 durability requirement. However, where a *building element* serves two purposes, only one of which must satisfy the NZBC, it shall have the durability appropriate to its location and use. For example, a decorative finish applied to a *building element* required by the NZBC to have an impervious easily cleaned surface will need to satisfy the 5 year durability performance.

## 1.1 Compliance documents

**1.1.1** *Building elements*, including materials, components and systems, complying with a publication referenced in the Compliance Documents, satisfy B2 requirements only when the conditions of use stated in the publication and Compliance Documents prevail.

### COMMENT:

It is not practicable within the Compliance Documents to cover all possible combinations, uses and conditions which may be applied to a *building element*. In special circumstances and where elements are called up but are used outside the scope of the Compliance Document application, durability shall be verified by B2/VM1.

Amend 6  
Sep 2010

## 1.2 Assessing required durability

**1.2.1** Evaluation of *building elements* shall be based on the following concepts:

- a) **Difficult to access or replace** – applies to *building elements* where access or replacement involves significant removal or alteration of other *building elements*. Examples are works involving the removal of masonry or concrete construction, or structural elements or repair of buried tanking membranes. A 50 year durability is required.
- b) **Moderately difficult to access or replace** – applies to *building elements* where access or replacement involves the removal or alteration of other *building elements*. Examples are the replacement of services reticulation in wall cavities and skillion roofs, or of plant and hotwater cylinders built into roof spaces without adequately sized access openings. A 15 year durability is required.
- c) **Easy to access and replace** – applies to *building elements* where access or replacement involves little alteration or removal of other *building elements*. Examples are linings, trim, light fittings, hotwater cylinder elements and door hardware, or where specific provision for removal has been made. A 5 year durability is required.
- d) **Failure to comply with the NZBC would go undetected during both normal use and maintenance of the building** – applies where the *building elements* are hidden from view with no provision for inspection access, and failure would not be apparent until significant damage had occurred to other *building elements*. Examples are building paper behind a masonry veneer cladding, and insulation in a skillion roof. A 50 year durability is required.
- e) **Failure to comply with the NZBC would go undetected during normal use of the building but would be easily detected during normal maintenance** – applies where normal maintenance will identify faults unlikely to be observed by *building occupants* until significant damage has occurred. Examples are degradation of exterior claddings on roofs and walls, sealant filled joints, flashings, services with specific provision for inspection access, chimneys and flues. A 15 year durability is required.

f) **Failure to comply with the NZBC would be easily detected during normal use of the building** – applies where the failure is obvious to the *building* occupants. Examples are exposed *building elements* which are damaged or inoperative such as protective finishes, essential signs, sticking doors, slip resistant surfaces, stair treads and surface-run *building services* equipment. A 5 year durability is required.

1.2.2 Figure 1 provides a means of assessing the durability requirements for *building elements*.

### 1.3 Examples of durability requirements

1.3.1 Table 1 is an acceptable solution establishing durability requirements of nominated *building elements*.

## 2.0 Maintenance

### 2.1 Normal maintenance

2.1.1 Normal maintenance is that work generally recognised as necessary to achieve the expected durability for a given *building element*. The extent and nature of that maintenance will depend on the material, or system, its geographical location and position within the *building*, and can involve the replacement of components subject to accelerated wear.

2.1.2 It is the responsibility of the person specifying the *building element* to determine normal maintenance requirements. These may be based on the manufacturer's recommendations and may also include periodic inspections of elements not readily observable without a specific effort (e.g. access to roof or subfloor spaces).

2.1.3 Basic normal maintenance tasks shall include but not be limited to:

- Where applicable, following manufacturers' maintenance recommendations,
- Washing down surfaces, particularly exterior *building elements* subject to wind driven salt spray,

- Re-coating interior and exterior protective finishes,
- Replacing sealant, seals and gaskets in joints,
- Replacing valves, washers and similar high wear components in easily accessed service equipment and other *building elements*,
- Cleaning and replacing filters in *building services* systems,
- The regular servicing of boilers, cooling towers, lifts, escalators, emergency lighting and fire protection equipment, and
- The maintenance of signs for access, *escape routes*, emergency equipment and *hazardous areas*.

#### COMMENT:

Maintenance does not include such things as upgrading *building elements* to meet the demands of new technology or the increased environmental expectations of users.

### 2.2 Scheduled maintenance

2.2.1 Scheduled maintenance comprises the inspection, maintenance and reporting procedures for *building elements* required to have a *compliance schedule* in terms of section 44 of the Building Act. By those procedures the *building elements* concerned are effectively deemed to have a durability of the life of the *building* because they are required to perform as designed at all times. The relevant maintenance procedures may include total replacement.

## 3.0 Generic Materials

### 3.1 Concrete

3.1.1 **NZS 3101:** Part 1 Section 3 is an acceptable solution for meeting the durability requirements of concrete building elements subject to the following modification:

Provisions in this Standard that are in non-specific or unquantified terms do not form part of the Acceptable Solution. Non-specific

Amend 6  
Sep 2010

or unquantified terms include, but are not limited to, special studies, manufacturer's advice and references to methods that are appropriate, adequate, suitable, relevant, satisfactory, acceptable, applicable, or the like. Such provisions must be treated as the basis of an alternative solution proposal.

Amend 6  
Sep 2010

### 3.2 Timber

**3.2.1** The following Standards form an *Acceptable Solution* for B2/AS1 meeting the durability requirements of timber *building elements*,

- a) Part 1 of NZS 3602 for listed species, excluding radiata pine and Douglas fir solid timber
- b) NZS 3640 and Part 1 of NZS 3602 for radiata pine and Douglas fir solid timber, with the amendments set out in Paragraphs 3.2.2 and 3.2.3
- c) NZS 3604, with reference to NZS 3602 (and NZS 3640) as amended in Paragraph 3.2.1 b).

#### COMMENT:

The use of different timbers or timber treatments to those referred to in NZS 3602 are outside the scope of this *Acceptable Solution*. Where the use of a different timber or timber treatment is proposed, it shall be separately assessed for compliance with the *Building Code*. For example, if imported hard-wood is to be used to surface a deck, evidence that the timber was *durable* for a minimum of 15 years in the expected exposure conditions is required.

#### 3.2.2 Amendments to NZS 3602 for Paragraph 3.2.1 b) above.

**3.2.2.1** Level of treatment references to radiata pine and Douglas fir solid timber in Table 1 categories 'C', 'D' and 'E' and Table 2 category 'B' shall be replaced by Tables 1A and 2A below. Table 1A and Table 2A are to be read with NZS 3602 sections 108 to 111 inclusive, with the amendments in Paragraph 3.2.2.3 below.

Other references to radiata pine and Douglas fir solid timber in NZS 3602, including Table 1 categories 'A', & 'B'; Table 2 category 'A'; and Table 3 are unaltered.

Amend 7  
Apr 2011

**Table 1A Requirements for radiata pine and Douglas fir solid timber to achieve a (minimum) 50 year durability performance**

Ref No.	Wood-based building components	Species or type	Level of treatment <sup>(2)</sup> to NZS 3640
<b>C – Members protected from the weather but exposed to ground atmosphere (see section 108 of NZS 3602)</b>			
1C.1	Jackstuds, subfloor braces, bearers, wall plates, floor joists to the subfloor, blocking, subfloor wall studs, wallings and battens, wall studs and noggs, diagonal boards	Radiata pine Douglas fir	H1.2
1C.3	Interior flooring, suspended ground floors	Radiata pine Douglas fir	H1.2
<b>NOTE</b>			
(2) Throughout Table 1A, timber treated to a higher level than the minimum satisfies the minimum requirements			
<b>D – Members protected from the weather but with a risk of moisture penetration conducive to decay (see section 109 of NZS 3602)</b>			
<b>Roof members (in or associated with)</b>			
1D.1	Sarking and framing not protected from solar driven moisture through absorbent cladding materials <sup>(8)</sup>	Radiata pine Douglas fir	H1.2
1D.2	Enclosed flat roof framing and associated roof members	Radiata pine Douglas fir	H1.2
1D.3	Enclosed skillion roof framing and associated roof members	Radiata pine Douglas fir	H1.2
1D.4	Valley boards and boards supporting flashings or box gutters and flashings to roof penetrations and upstands to roof decks <sup>(10)</sup>	Radiata pine Douglas fir	H1.2
<b>Wall members (in or associated with)</b>			
1D.5	Framing and other members within or beneath a parapet	Radiata pine Douglas fir	H1.2
1D.6	Framing, and other members within enclosed decks or balconies	Radiata pine Douglas fir	H1.2
1D.7	Cantilevered enclosed deck joists and associated framing including joist trimmers, noggs, and blocking <sup>(5)</sup>	Radiata pine Douglas fir	H3.2
1D.8	Framing and other members supporting enclosed decks (including enclosed cantilevered decks) or balconies	Radiata pine Douglas fir	H1.2
1D.10	Battens used behind cladding to form a cavity	Radiata pine Douglas fir	H3.1
1D.14	All other exterior wall framing and other members including exterior and boundary joist <sup>(9)</sup> <sup>(11)</sup>	Radiata pine Douglas fir <sup>(14)</sup>	H1.2

**NOTE**

(5) H3.2 refers to preservative treatments outlined in NZS 3640.

(8) Timber shakes and shingles, and similar absorbent claddings, absorb moisture that can be driven in frame cavities by evaporation. Unless the cavities are adequately drained and ventilate, continuing condensation caused by solar driven transfer increases the moisture content in the cavities and timber framing requiring a higher level of timber treatment to resist decay.

(9) Such as joists, lintels, wall plate and double top plates, studs, together with parapets, enclosed balustrades, boxed columns and chimneys

(10) Any metal flashing shall be separated from the treated timber with building paper.

(11) Exposed ends of joists shall be protected by a boundary joist.

Amend 7  
Apr 2011

15A

4 April 2011

DEPARTMENT OF BUILDING AND HOUSING

**Table 1A** Requirements for radiata pine and Douglas fir solid timber to achieve a (minimum) 50 year durability performance  
(continued)

Ref No.	Wood-based building components	Species or type	Level of treatment <sup>(2)</sup> to NZS 3640
<b>E – Members not exposed to weather or ground atmosphere and in dry conditions (see section 110 of NZS 3602)</b>			
1E.1	All roof trusses, including gable end trusses, roof framing, ceiling and eaves framing, purlins and battens	Radiata pine Douglas fir <sup>(14)</sup>	H1.2
1E.2	All midfloor framing including boundary joists, ceiling framing, ceiling battens, and double top plates	Radiata pine Douglas fir <sup>(14)</sup>	H1.2
1E.3	Wall framing and roof framing (including trusses) protected from the weather, in unlined and unoccupied farm buildings and outbuildings except those not allowed in 110.2(f) of NZS 3602	Radiata pine Douglas fir	None
1E.5	Internal walls	Radiata pine Douglas fir <sup>(14)</sup>	H1.2
1E.7	Interior flooring	Pinus species Douglas fir <sup>(14)</sup>	H1.2

## NOTE

(14) Exceptions to the levels of treatment for Douglas fir are provided in Paragraph 3.2.2.2 of this *Acceptable Solution B2/AS1*.

**Table 2A** Requirements for radiata pine and Douglas fir solid timber to achieve a 15-year durability performance

Ref No.	Wood-based building components	Species or type	Level of treatment <sup>(2)</sup>
<b>B – Members protected from the weather and dampness (see section 111 of NZS 3602)</b>			
2B.1	Non-load bearing interior wall framing	Radiata pine Douglas fir <sup>(9)</sup>	H1.2
2B.2	Stair treads, risers and handrails	Radiata pine Douglas fir <sup>(9)</sup>	None

## NOTE


(2) Throughout Table 2A, timber treated to a higher level than the minimum satisfies the minimum requirements.

(9) Exceptions to the levels of treatment for Douglas fir are provided in Paragraph 3.2.2.2 of this *Acceptable Solution B2/AS1*.

Amend 7  
Apr 2011

**COMMENT:**

Summary of requirements for radiata pine and Douglas fir framing for B2/AS1

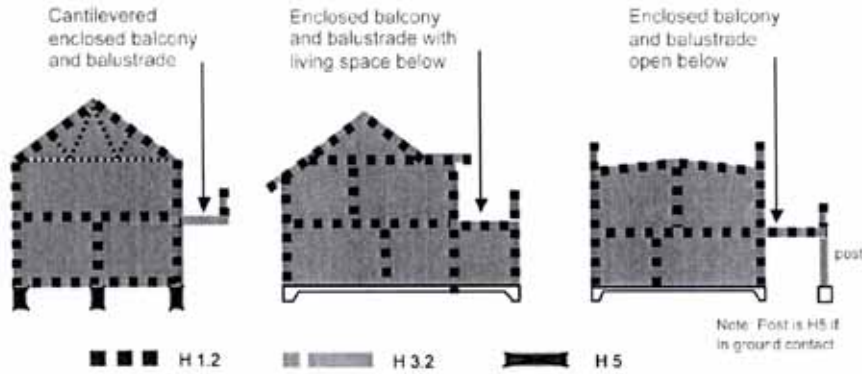

**3.2.2.2 Exceptions for the use of untreated Douglas fir**

Preservative-free (untreated) solid Douglas fir framing may be used for roof members protected from the weather, floor members protected from the weather and not exposed to ground atmosphere, and for internal and external wall framing protected from the weather provided that the *building* meets all of the following requirements:

- a) is a stand alone, single household unit of no more than two storeys (as defined in NZS 3604) and designed and constructed to NZS 3604, and
- b) is situated in wind zones no greater than High as defined in NZS 3604, and
- c) has an envelope complexity of no greater than medium risk and a deck design no greater than low risk as defined by the risk matrix in E2/AS1, and
- d) has drained and vented cavities complying with E2/AS1 behind all claddings, and
- e) uses roof and wall cladding systems and details conforming with Acceptable Solution E2/AS1, and

- f) has a risk matrix score of no more than 6 on any external wall face as defined in E2/AS1, and
- g) has a simple pitched roof incorporating hips, valleys, gables, or mono pitches, all draining directly to external gutters; but excluding internal or secret gutters, concealed gutters behind fascias, or any roof element finishing within the boundaries formed by exterior walls (eg, the lower ends of aprons, chimneys, dormers, clerestories, box windows, etc), and
- h) has a roof slope of not less than 10°, and
- i) if it has a skillion roof, then the roofing material shall be corrugated iron or concrete, metal or clay tiles to ensure adequate ventilation, and
- j) has eaves 450 mm wide or greater for single storey houses, and eaves 600 mm or greater for two storey houses.

**COMMENT:**

This Paragraph 3.2.2.2 provides an option for those who do not want to use chemically treated timber in their home. In the case of commercial or other building categories, the use of untreated Douglas fir to comply with the *Building Code* is outside the scope of this *Acceptable Solution* and needs to be considered on a case-by-case basis.

Amend 7  
Apr 2011

Amend 7  
Apr 2011

15C

4 April 2011

DEPARTMENT OF BUILDING AND HOUSING

**3.2.2.3 Amendments to NZS 3602 sections 109, and 110**

Table 1A and Table 2A are to be read with NZS 3602 sections 109 and 110 including amendments below.

- 109.2 (a) (iii) Delete and replace with:  
Members supporting enclosed cantilevered decks having increased risk of failure due to there being single points of support.
- 109.2 (b) Delete and replace with:  
Timber framed elements exposed to exterior weather conditions on both faces such as parapets and balustrades, or exterior boxed beams columns or chimneys.
- 109 (c) (vi) Delete
- 109 (c) (vii) Delete and replace with:  
Framing and other members in exterior walls including boundary joists.
- Figure 1 Delete
- Figure 2 Delete
- Figure 3 Delete
- 110.2 (b) Delete
- 110.2 (c) Delete and replace with:  
Internal walls
- 110.3.1 Delete and replace with:  
Floor coverings in 'wet areas' such as laundries, bathrooms, kitchens and toilets shall be as set out in E3/AS1. Where maintenance of an impervious coating cannot be assured in wet areas, plywood flooring treated to minimum H3, or solid pinus species or Douglas fir flooring treated to minimum H1.2, shall be used.

**COMMENT:**

For Paragraph 3.2.1 a) above, sections 109 and 110 of NZS 3602 remain unaltered.

Amend 7  
Apr 2011

### 3.2.3 Amendments to NZS 3640 for 3.2.1 b) above.

**3.2.3.1** The following treatments listed in NZS 3640 shall not be used as framing preservative: Bis-(tri-n-butyltin) oxide (TBTO), Bis-(tri-n-butyltin) naphthenate (TBTN), and Iodo propynyl butyl carbamate (IPBC).

**3.2.3.2** Table 4.4 – remove H1.2 from the hazard classes column in the Copper naphthenate (CuN) line.

**COMMENT:**

Including H1.2 hazard class for CuN is inconsistent with H1.2 preservatives listed in Table 6.1.

**3.2.3.2** Table 5.2 – Colour coding for timber to be used as framing shall be replaced with the following Table:

**Table 5.2** Colour coding for timber to be used as framing

Hazard class	Preservative	Colour <sup>(1)</sup>
H1.2	Boron	Pink <sup>(2)</sup>
H3.1	Propiconazole + tebuconazole/permetherin	No added colour <sup>(3)</sup> or green <sup>(4)</sup>

Note –

(1) These colours shall not be used for any preservative types/hazard classes other than specified.

(2) Colour – Red 112 (red) or Red 122 (pink).

(3) H3.1 framing shall be branded repetively along the length at 1500 mm centres maximum on its face or edge.

(4) If coloured green, the colour is to be distinctly different (Colour Green 368) from the green of the H3.2 preservative treatment – see C Table 5.2 (a) below.

**3.2.3.3** Table 6.1 – Minimum preservative retention in the H1.1, H1.2 analysis zone (sawn timber), shall be replaced with the following table:

**Table 6.1** Minimum preservative retention in the H1.2 analysis zone (sawn timber)

Preservative type	Component	Retention %m/m oven Dry weight of wood
H1.2		
Waterborne preservatives		
Boron compounds –		
Softwoods x-sect	H <sub>3</sub> BO <sub>3</sub>	0.40 <sup>(1)</sup>

Note:

(1) This cross-section retention is required whether the material is sampled wet, where the timber is intended to be air dried, or on the dry timber

Amend 7  
Apr 2011

15E

4 April 2011

DEPARTMENT OF BUILDING AND HOUSING

**3.2.3.4** Note (1) of Table 6.2 shall be deleted and replaced with the following:

(1) Boron compounds are approved for H3.1 only for timber boards for fascia, cladding, joinery, cavity battens and other timber components less than 30 mm thick and only when an oil alkyd, modified acrylic or modified latex grey pigmented coating is applied to all timber surfaces, after treatment and before dispatch from the treatment plant.

Amend 7  
Apr 2011


### **3.3 Solid plastering**

**3.3.1** NZS 4251: Part 1 is an acceptable solution for meeting the durability requirements of cement plasters for walls, ceilings and soffits within its scope.

### **3.4 Earth buildings**

**3.4.1** NZS 4297 and NZS 4299 are acceptable solutions for meeting the durability requirements of earth *buildings* within their scope.

Amend 2  
Dec 2000

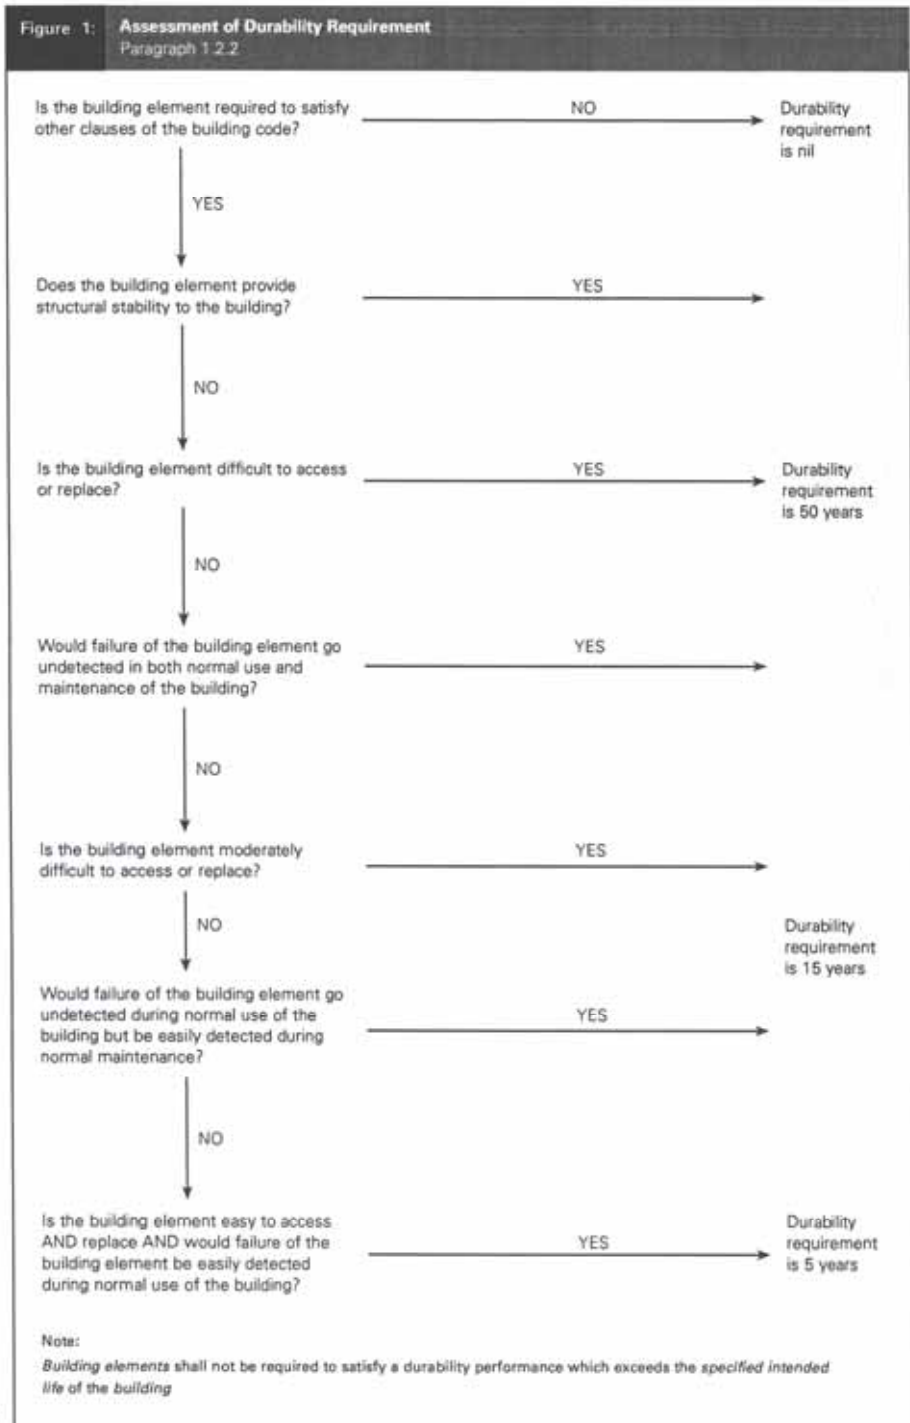

16

**Table 1: Durability Requirements of Nominated Building Elements**

Note: Clause B2.3.2 requires that all hidden elements have at least the same durability as that of the element that covers it (i.e. must have the same expected life) which may be more than the requirement in clause B2.3.1. For example, the reason that a brick tie has a requirement of not less than 50 years in this table, instead of the 15 year requirement for cladding, is that the brick veneer that hides it has an expected durability of 50 years or more.

Building Element	Component	Situation/Function	Not less than 50 years	Not less than 15 years	Not less than 5 years
<b>Acoustic elements</b>		Covered by or integral with structural elements or bracing panels	✓		
		Behind non-structural claddings or linings	✓		
		Surface mounted		✓	
<b>Balustrade</b>	(Refer to safety barrier)				
<b>Battens</b> (Cavity battens for wall cladding systems) (See note at top of table)	Battens	Where wall cladding durability requirement is 15 years		✓	
		Where wall cladding provides bracing	✓		
<b>Bracing Elements</b>		All – includes the bracing element and fixings	✓		
<b>Building wraps</b> (See also wind barriers) (See note at top of table)	Roof underlay	Access requires removal of roof tiles or structural elements	✓		
		Where roof cladding durability requirement is 15 years		✓	
	Wall underlay	Where wall cladding durability requirement is not less than 50 years (e.g. providing bracing, or where the cladding is very durable e.g. brick veneer)	✓		
		Where wall cladding durability requirement is 15 years		✓	
Wind barriers	Providing bracing (i.e. rigid wind barriers)	✓			
	Not providing bracing (non-rigid wind barriers)		✓		
<b>Cladding</b> (including jointing systems)	Roof	Structural	✓		
		Non-structural		✓	
	Wall	Structural including bracing elements	✓		
Non-structural			✓		
<b>Curtain walling</b>	Frames and fixings	All buildings	✓		
	Gaskets, glazing or panelling and beads			✓	
	Internal hardware				✓
<b>Damp-proof course (DPC)</b>	DPCs under timber members	Under structural framing	✓		
		Under non-structural framing		✓	
<b>Damp-proof membranes (DPM)</b> (See note at top of table)	Damp-proofing generally	DPMs under concrete floor slabs	✓		

Amend 4  
Apr 2004

Table 1: Durability Requirements of Nominated Building Elements (cont'd)

Building Element	Component	Situation/Function	Not less than 50 years	Not less than 15 years	Not less than 5 years
<b>Damp-proof membranes (DPM)</b> (Continued)	Damp-proofing generally	DPMs applied to the top of concrete slabs		✓	
		DPMs behind retaining walls used for landscaping		✓	
		DPMs designed for ready access and replacement		✓	
		DPM behind tiles		Same durability as the tile covering it	
	Water-proofing of basements	Tanking, except those designed for ready access	✓		
		Tanking designed for ready access		✓	
<b>Decking (timber)</b>	Decking	Structural (e.g. bracing diaphragm)	✓		
		Non-structural strip decking		✓	
	Sub-floor structure	All	✓		
<b>Demountable Partitions</b>	Partition including frame, fixings, and linings	All			✓
<b>Doors (including frame)</b>	Non fire rated doors	Internal			✓
		External		✓	
		Furniture and hardware			✓
	Fire rated doors	Internal		✓	
		External		✓	
		Furniture and hardware			✓
<b>Electrical work</b> (See note at top of table)	Wiring	Buried in or under concrete slabs or behind structural linings without ducts	✓		
		Concealed behind linings or in complex ducts or conduit, or surface mounted in conduit		✓	
		Wires in easy to access ducts			✓
		Fittings	Concealed and moderately difficult to access or replace	✓	
		Surface mounted			✓
	Ducting or conduit	Difficult to access or replace	✓		
		Moderately difficult to access or replace		✓	
<b>Fire rated walls</b>		Structural walls including bracing elements	✓		
		All others		✓	
<b>Fixings</b>	Nails and screws	Used to fix structural or difficult to replace building elements	✓		
		Under water-proof membranes	✓		
		Under roofing membranes	✓		
		Used to fix non-structural or moderately difficult to replace building elements		✓	
	Bolts	Used to fix structural or difficult to access or replace building elements including structural elements of decks and barriers	✓		

Amend 4  
Apr 2004

Table 1: Durability Requirements of Nominated Building Elements (cont'd)

Building Element	Component	Situation/Function	Not less than 50 years	Not less than 15 years	Not less than 5 years	
<b>Fixings</b> (Continued)	Bolts	Used to fix non-structural or moderately difficult to replace building elements		✓		
	Brick ties and fixings	All	✓			
	Proprietary fixings	Used to fix structural or difficult to replace building elements	✓			
		Used to fix non-structural or moderately difficult to replace building elements		✓		
	Adhesives	Used to fix structural or difficult to replace building elements	✓			
		Used to fix non-structural or moderately difficult to replace building elements		✓		
	Face fixings	Used to fix accessories, door furniture and hardware			✓	
<b>Flashings</b> (See note at top of table)	Roof, wall or window	All flashings to roof cladding, flues and other roof penetrations		✓		
		Requires the removal of cladding above the roof to be replaced	✓			
		Hidden flashings such as behind brick veneer, stucco or spandrel panels	✓			
		Visible and does not require the removal of the cladding to be replaced		✓		
		Requires the removal of the cladding to be replaced	✓			
<b>Flooring – sheet or strip</b> (See note at top of table)		Floor bracing diaphragm	✓			
		Flooring laid under bottom plates	✓			
		Flooring laid between bottom plates		✓		
<b>Floor coverings</b>		Protective or acoustic coverings			✓	
<b>Flue systems</b>	All flue systems	Those built into the floor, wall, ceiling or roof		✓		
		Those exposed to view or penetrating the floor, wall, ceiling or roof through a sleeve			✓	
<b>Framing</b>	(refer to wall framing or to roof framing as appropriate)					
<b>Guttering and downpipes</b> (See note at top of table)		Gutters or downpipes incorporated within the structure (e.g. downpipes cast into a column or boxed in behind claddings), or secret gutters (e.g. hidden verge or valley gutters)	✓			
		Internal or valley gutters, fascia gutters or built-in downpipes		✓		
		External gutters and downpipes			✓	
<b>Heating Appliances</b>	Solid fuel	Freestanding			✓	
		Inbuilt		✓	✓	
		Gas	Freestanding			✓
		Inbuilt		✓	✓	
	Electric	Permanently wired				✓

Amend 4  
Apr 2004

Table 1: Durability Requirements of Nominated Building Elements (cont'd)

Building Element	Component	Situation/Function	Not less than 50 years	Not less than 15 years	Not less than 5 years
Insulation	Sub-floor		✓		
	Walls		✓		
	Ceiling or roof	Skillion roof	✓		
		Accessible ceiling or roof space	✓		
Interior wall linings	Structural linings (e.g. bracing elements)		✓		
		Shower linings (excluding behind tiled showers)		✓	
	Linings behind tiled showers		Same durability as tile covering it		
		Easy to access and replace			✓
Lintels	Steel angle (brick veneer)	All situations	✓		
	Flat steel	All situations	✓		
Plumbing and piping	Piping and fittings	Cast into concrete	✓		
		Under slabs	✓		
		Installed in a masonry cavity and not ducted or provided with maintenance access	✓		
		Concealed behind wall linings or installed in maintenance ducting		✓	
		Surface mounted and easy to replace			✓
	Valves	Concealed or moderately difficult to replace		✓	
		Surface mounted and easy to replace			✓
	Fixtures				✓
		Outlets			✓
	Protective Coatings	Paint systems that are difficult to access or replace		✓	
Roofing membranes				✓	
Paint systems that are easy to access and replace				✓	
Roof framing including trusses, purlins, tile battens and bracing members			✓		
Roofing tile battens			✓		
Safety barrier (balustrade, baluster, and handrail)	Support posts, handrails		✓		
	Balusters			✓	
Septic tanks		Built into or under the structure of a building	✓		
		Easy to access units (e.g. in-ground but accessible)		✓	
		Effluent field		✓	

Amend 4  
Apr 2004

Table 1: Durability Requirements of Nominated Building Elements (cont'd)

Building Element	Component	Situation/Function	Not less than 50 years	Not less than 15 years	Not less than 5 years	
<b>Stairs and ladders</b> (for balustrades refer to safety barriers)	Stringers		✓			
	Treads	Difficult to replace	✓			
	Ladders including rungs	Moderately difficult to replace		✓		
<b>Tiling</b>	Walls and floors (including showers)	Tiling in wet areas		✓		
	Walls and floors	Decorative finish only	No durability requirement under the building code			
<b>Under-floor heating</b>	Heating coils	Buried in concrete slabs	✓			
		Accessible coils		✓		
<b>Vapour barriers</b>	Cables and fittings	Buried in concrete slabs	✓			
		Accessible cables and fittings		✓		
		Behind structural elements or difficult to access and replace	✓			
<b>Ventilation</b>	Plant	Behind non-structural internal linings		✓		
		High gloss paint finish			✓	
		All		✓		
<b>Vermin proofing</b>	Ducting	Built-in ducting		✓		
		Easy to access and replace			✓	
<b>Water heaters</b>	Fittings	Built into structure	✓			
		Moderately difficult to access or replace		✓		
		To drained ventilated cavity	Same durability as the cladding covering it			
<b>Wall framing including dwangs or nogging</b>	Continuous flow heaters	Moderately difficult to access or replace (e.g. installed in cupboard)		✓		
		Easy to access or replace (e.g. on internal or external wall)			✓	
		Moderately difficult to access or replace (e.g. installed in cupboard)		✓		
<b>Windows</b>	Storage water heaters	Easy to access but moderately difficult to replace		✓		
		Load-bearing framing	✓			
		Easy to access lined, non-load-bearing partitions		✓		
<b>Windows</b>	Timber or steel	Easy to access unlined, non-structural partitions or non-load-bearing demountable partitions			✓	
		Structural Steel	All	✓		
		Frame and interior reveals	Structural units	✓		
		External window/door joinery		✓		
		Internal window joinery			✓	

Amend 4  
Apr 2004

**Table 1: Durability Requirements of Nominated Building Elements (cont'd)**

Building Element	Component	Situation/Function	Not less than 50 years	Not less than 15 years	Not less than 5 years
Windows (Continued)	Gaskets, glazing and glazing beads	Moderately difficult to access or replace		✓	
	Hardware				✓

Amend 4  
Apr 2004

# Index B2/VM1 & AS1

All references to Verification Methods and Acceptable Solutions are preceded by **VM** or **AS** respectively.

	<b>Concrete</b> .....	<b>AS1 3.1.1</b>
	<b>Durability evaluation</b> .....	<b>VM1 1.0, AS1 1.2, Figure 1</b>
Amend 4 Apr 2004	examples of requirement .....	<b>AS1 1.3.1, Table 1</b>
	generic materials .....	<b>AS1 3.0</b>
	in-service history .....	<b>VM1 1.1</b>
	laboratory testing .....	<b>VM1 1.2</b>
	similar materials .....	<b>VM1 1.3</b>
Amend 2 Dec 2000	<b>Earth buildings</b> .....	<b>AS1 3.4</b>
	<b>Ease of access and replacement</b> .....	<b>AS1 1.2.1</b>
	<b>Maintenance</b> .....	<b>AS1 2.0</b>
	normal .....	<b>AS1 2.1</b>
	scheduled .....	<b>AS1 2.2</b>
Amend 2 Dec 2000	<b>Solid plastering</b> .....	<b>AS1 3.3</b>
	<b>Timber</b> .....	<b>AS1 3.2</b>

## QUIZ ON ARTICLES IN THIS NEWS SHEET



1. Clause B2 Durability latest amendment 7 comes into full effect from \_\_\_\_\_.
  - a. 1 April 2011
  - b. 1 June 2011
  - c. 1 July 2011
2. Amendment 6 of clause B2 Durability has a transition period up to \_\_\_\_\_.
  - a. 1 April 2011
  - b. 30 June 2011
  - c. 30 July 2011
3. The changes to clause B2 Durability are only in the acceptable solution B2 / AS1.
  - a. True
  - b. False
4. The references in B2 Durability include NZS 3604, 2011.
  - a. True
  - b. False
5. Under the definitions in B2 Durability, a person is:
  - a. a single person
  - b. excludes the crown
  - c. includes the crown, a corporation sole and also a body of persons whether corporate or unincorporated.
6. Under the definitions in B2 Durability an unprotected area includes non fire rated windows, doors or other openings and non fire rated external wall construction.
  - a. True
  - b. False
7. Under clause B2 Durability amendment 7 has changes to the verification method.
  - a. True
  - b. False
8. The acceptable solution B2 / AS1 has sections on maintenance and scheduled maintenance.
  - a. True
  - b. False
9. Under the acceptable solution B2 / AS1, table 1A, timber used for interior flooring – radiata pine and Douglas fir is required to be treated to:
  - a. H1.1
  - b. H1.2
  - c. H3.2
10. Under the acceptable solution B2 / AS1, table 1A, battens used behind cladding to form a cavity are required to be treated to:
  - a. H1.1
  - b. H1.2
  - c. H3.1

11. Under the acceptable solution B2 / AS1, table A1, cantilevered enclosed deck joists and associated framing are required to be treated to:
  - a. H1.2
  - b. H3.1
  - c. H3.2
12. Under the acceptable solution B2 / AS1, table A1, any metal flashing shall be separated from treated timber with:
  - a. an air gap
  - b. a timber batten
  - c. building paper
13. Under the acceptable solution B2 / AS1, table A1, all roof trusses and purlins are required to be treated to:
  - a. H1.1
  - b. H1.2
  - c. H3.1
14. Under the acceptable solution B2 / AS1, table A1, eaves framing are required to be treated to:
  - a. H1.1
  - b. H1.2
  - c. H3.1
15. Under the acceptable solution B2 / AS1, table A1, an internal timber stair treat risers and handrails require no timber treatment.
  - a. True
  - b. False
16. Under the acceptable solution B2 / AS1, untreated Douglas fir can be used for roof members as long as certain conditions are met.
  - a. True
  - b. False
17. Under the acceptable solution B2 / AS1, untreated Douglas fir can be used in a very high wind zone.
  - a. True
  - b. False
18. Under the acceptable solution B2 / AS1, colour coding for hazard class H1.2 shall be:
  - a. Black
  - b. Green
  - c. Pink
19. Under the acceptable solution B2 / AS1, hazard class H3.1 can have no colour but must be branded repetitively along the length at \_\_\_\_\_mm.
  - a. 1000mm
  - b. 1500mm
  - c. 2000mm
20. Under the acceptable solution B2 / AS1, the assessment of durability requirement figure 1 has changed significantly from previous amendments of B2 / AS1.
  - a. True
  - b. False

The following questions relate to durability requirements of building elements from Table 1 B2 / AS1.

21. A cavity batten requires what durability when attached to a wall cladding providing bracing?
  - a. 5 years
  - b. 15 years
  - c. 50 years
22. A cavity batten requires what durability where the wall cladding durability requirement is 15 years?
  - a. 5 years
  - b. 15 years
  - c. 50 years
23. A damp proof course DPC requires what durability when used under non structural timber framing?
  - a. 5 years
  - b. 15 years
  - c. 50 years
24. A nail, screw or bolt used to fix non structural or moderately difficult to replace building elements requires what durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years
25. An external gutter or downpipe requires that durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years
26. A free standing solid fuel burner requires what durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years
27. An inbuilt solid fuel burner requires what durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years
28. Insulation requires what durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years
29. A safety barrier (balustrade, baluster and handrail) requires what durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years
30. A valve on a plumbing system that is concealed or moderately difficult to replace requires what durability?
  - a. 5 years
  - b. 15 years
  - c. 50 years

## ANSWERS TO QUIZ



- |       |       |
|-------|-------|
| 1. a  | 16. a |
| 2. b  | 17. b |
| 3. a  | 18. c |
| 4. b  | 19. b |
| 5. c  | 20. b |
| 6. a  | 21. c |
| 7. b  | 22. b |
| 8. a  | 23. b |
| 9. b  | 24. b |
| 10. c | 25. a |
| 11. b | 26. a |
| 12. c | 27. b |
| 13. b | 28. c |
| 14. b | 29. c |
| 15. a | 30. b |